

21

33 4
33 4
2.8
20 2 4

24,210t CO
24,210t
31 k
1
20 652t CO

21 5
21 5
20 2 2

横浜市水道局

22

()

URL <http://www.city.yokohama.jp/me/suidou/>



22 12

TEL045-671-3066 FAX045-664-6774


	21	20	
1	842,464	604,293	238,171
	1,066,424	1,009,361	57,063
	1,165,372	1,211,166	45,795
	3,074,260	2,824,820	249,439
2	172,076	161,192	10,884
3	7,056	11,211	4,155
4	82,411	98,639	16,228
	3,335,803	3,095,862	239,940

	21	20	
(1)			
	2,061 -CO /	2,750 -CO /	689 -CO /
	620 /	867 /	247 /
	539 /	703 /	164 /
(2)			
	446 -CO /	409 -CO /	37 -CO /
	21,703 -CO /	21,703 -CO /	0 -CO /
(3)			
	151,725	148,848	2,877
	25,064	22,085	2,979
	116,074	109,271	6,803
	112,980	104,163	8,816
	1,571 D - /	1,930 D - /	359 D - /
	24,210 -CO /	24,862 -CO /	652 -CO /

	2	20	
	49,828	35,241	14,587
	2,826	5,401	2,575
	52,654	40,642	12,012
	1,494,177	1,346,941	147,236
	47,946	57,048	9,102
	559,910	489,453	70,457
	2,102,033	1,893,442	208,591
	2,154,687	1,934,084	220,603

上手に使おう 横浜の水
～健康と豊かな暮らしは蛇口から～



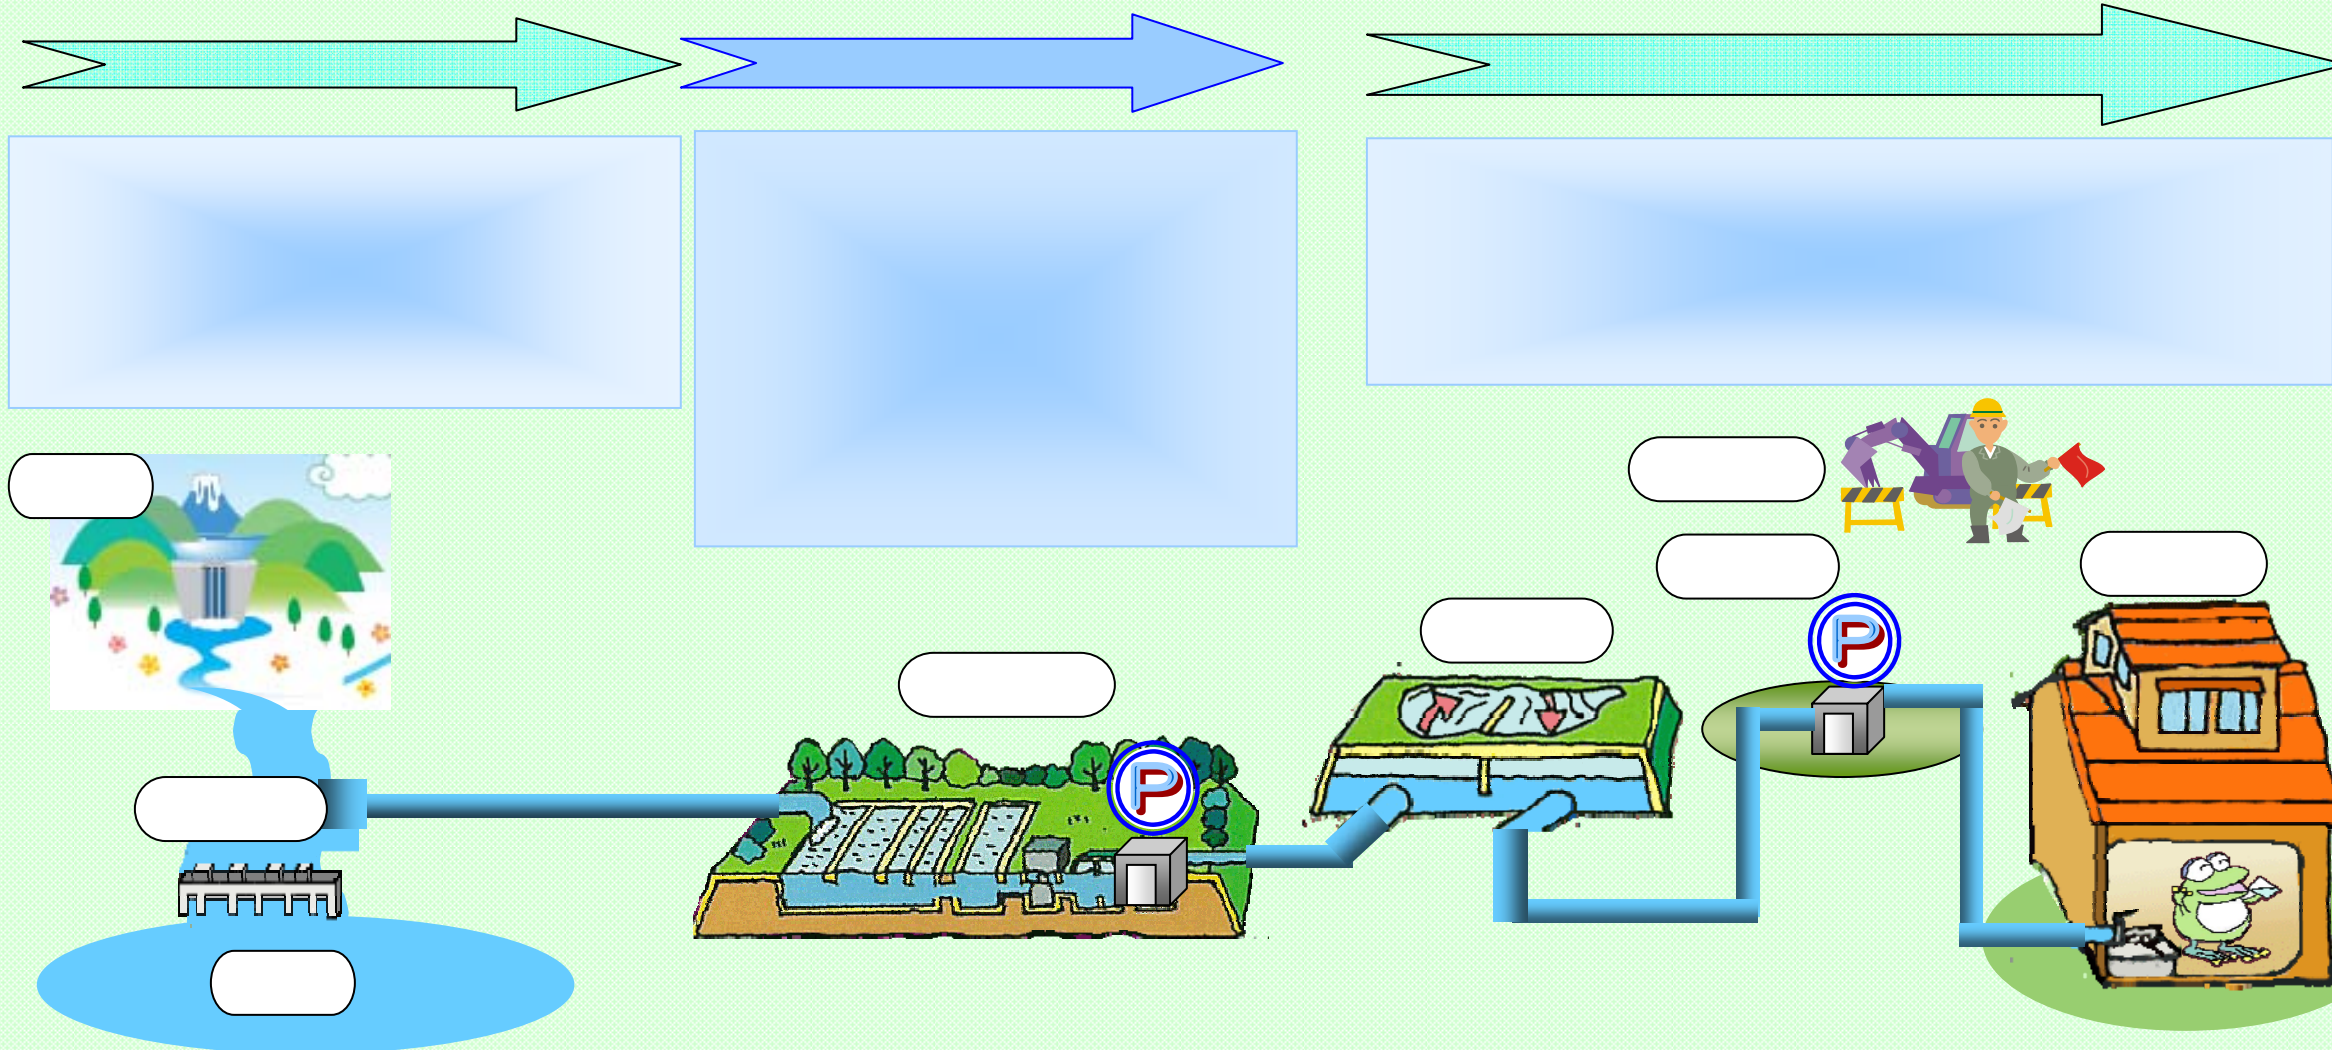

21
.....1 3,096 kWh
.....1,096,731
.....15 ³
.....9,790
.....,184

21
.....65,714 -CO /
.....185 /
.....74 /
.....4,733DS- /
.....15 ³ /
65,714 -CO 8,647 a
1 C
DS- Dry Sludge-t



1.1
178 20 1 ³ 176
728

CO₂ NO_x SO_x